




ARE YOU READY?

With only **two cooling seasons** remaining before R-22 production allowances reach 0, have you prepared your facility and equipment?

WHAT IS THE R-22 PHASE OUT?

Equipment manufacturers, refrigerant suppliers and distributors have all been preparing for the **January 1, 2020 cutoff** when no new or imported R-22 refrigerant will be allowed in the U.S. There are two cooling seasons remaining before R-22 production allowances reach 0.

EPA Final Rule: R-22 Production Allowances

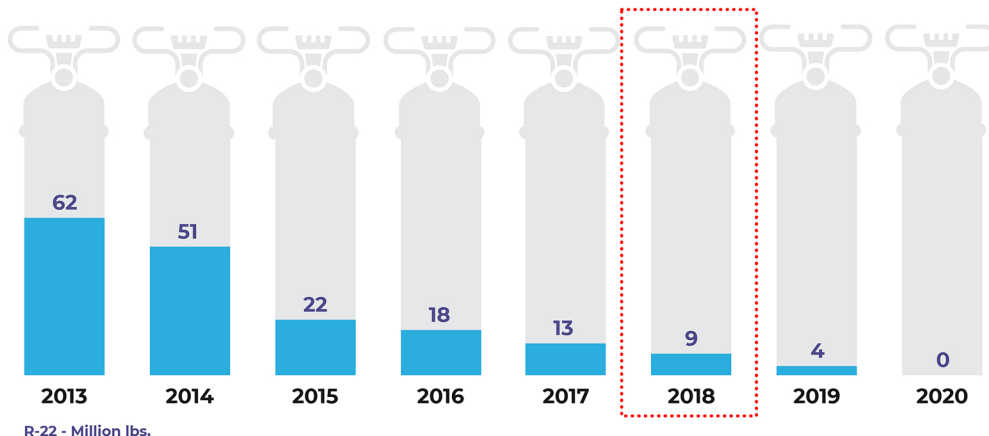

WITH THIS IN MIND, IT
IS **CRITICAL** TO HAVE
A PLAN TO MANAGE
YOUR EQUIPMENT
AND REFRIGERATION.

REFRIGERANT MANAGEMENT PLANNING: THE SEVEN R'S



RECORDKEEPING

Equipment owners are legally responsible for **keeping records** about maintenance of your equipment. For Rieck customers, we have kept those records for you.



REPAIR

Repair leaks and maintain equipment performance. This is not only the right thing to do for the environment, but refrigerant loss is in direct correlation with how well your system operates.



RETROFIT

Retrofit your existing equipment with R-22 alternatives.



REPLACE


Replace equipment that has reached the end of its useful life – this is a necessary part of your equipment plan.

RECOVER, RECYCLE & RECLAIM

Recover refrigerant out of equipment before you dispose of it or before you put another gas in. **Recycle** gas by putting it back into another piece of equipment owned by the **same owner**. **Reclaim** refrigerant means reprocessing it by returning to a refrigerant reclaim center for proper EPA processing. Refrigerant reclamation facilities must be certified by the U.S. EPA.



R-22 REFRIGERANT MANAGEMENT PLAN

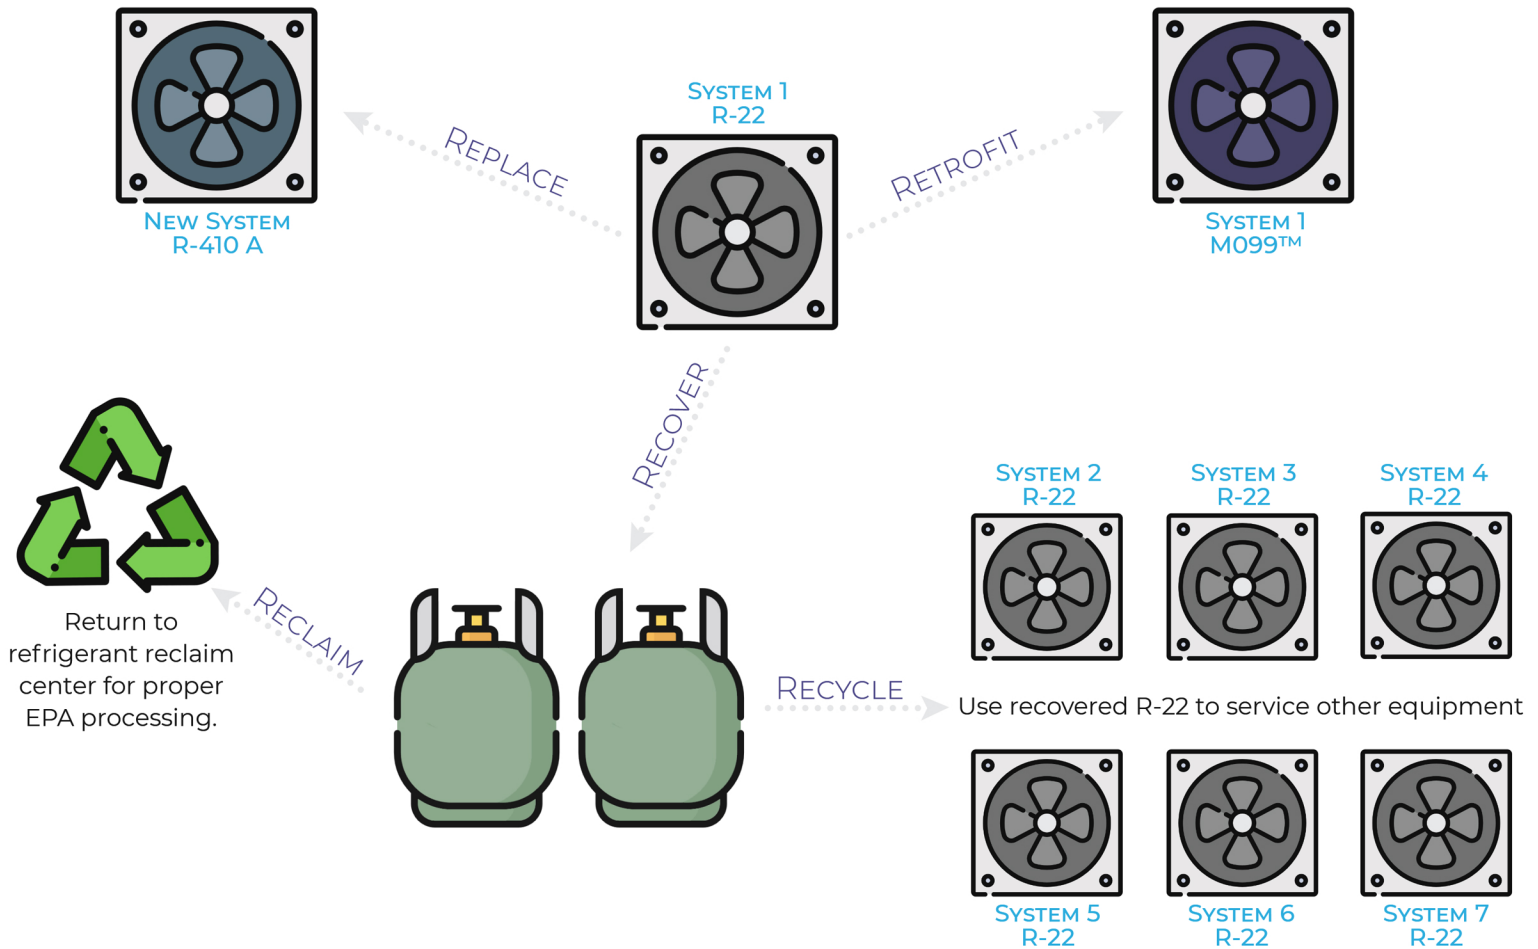

For assistance developing your refrigerant management plan, contact Rieck Services today at:

(937) 274-1987

info@rieckservices.com

www.rieckservices.com

